

Overview of Establishment of the Regional Energy Shortfall Threshold (REST)



*NECPUC Retail Demand & Load Flexibility
Working Group*

Stephen George

DIRECTOR, OPERATIONAL PERFORMANCE, TRAINING & INTEGRATION



Energy Adequacy Study Key Takeaways


- [Final Report](#) released in December 2023 includes results of energy assessments completed for winter and summer 2027 and 2032 events, and reviews 2032 sensitivity analysis
- In the near-term, the winter energy shortfall risk appears manageable over a 21-day period; sensitivity analysis of 2032 worst-case scenarios indicate an increasing energy shortfall risk profile between 2027 and 2032
- Timely additions of BTM and utility-scale PV, offshore wind, and incremental imports from NECEC are critical to mitigate energy shortfall risks that result from significant peak winter load growth and retirements
- The Probabilistic Energy Adequacy Tool (PEAT) developed in partnership with EPRI provides a much needed foundation for the ISO to monitor risks and study the system as it continues to evolve



Results Highlight the Impact of Retirements and Electrification on Energy Shortfall Amounts

Energy Shortfall: 2032 Sensitivities

Worst case (low oil/LNG/imports), Jan. 22 1961 (W1) event

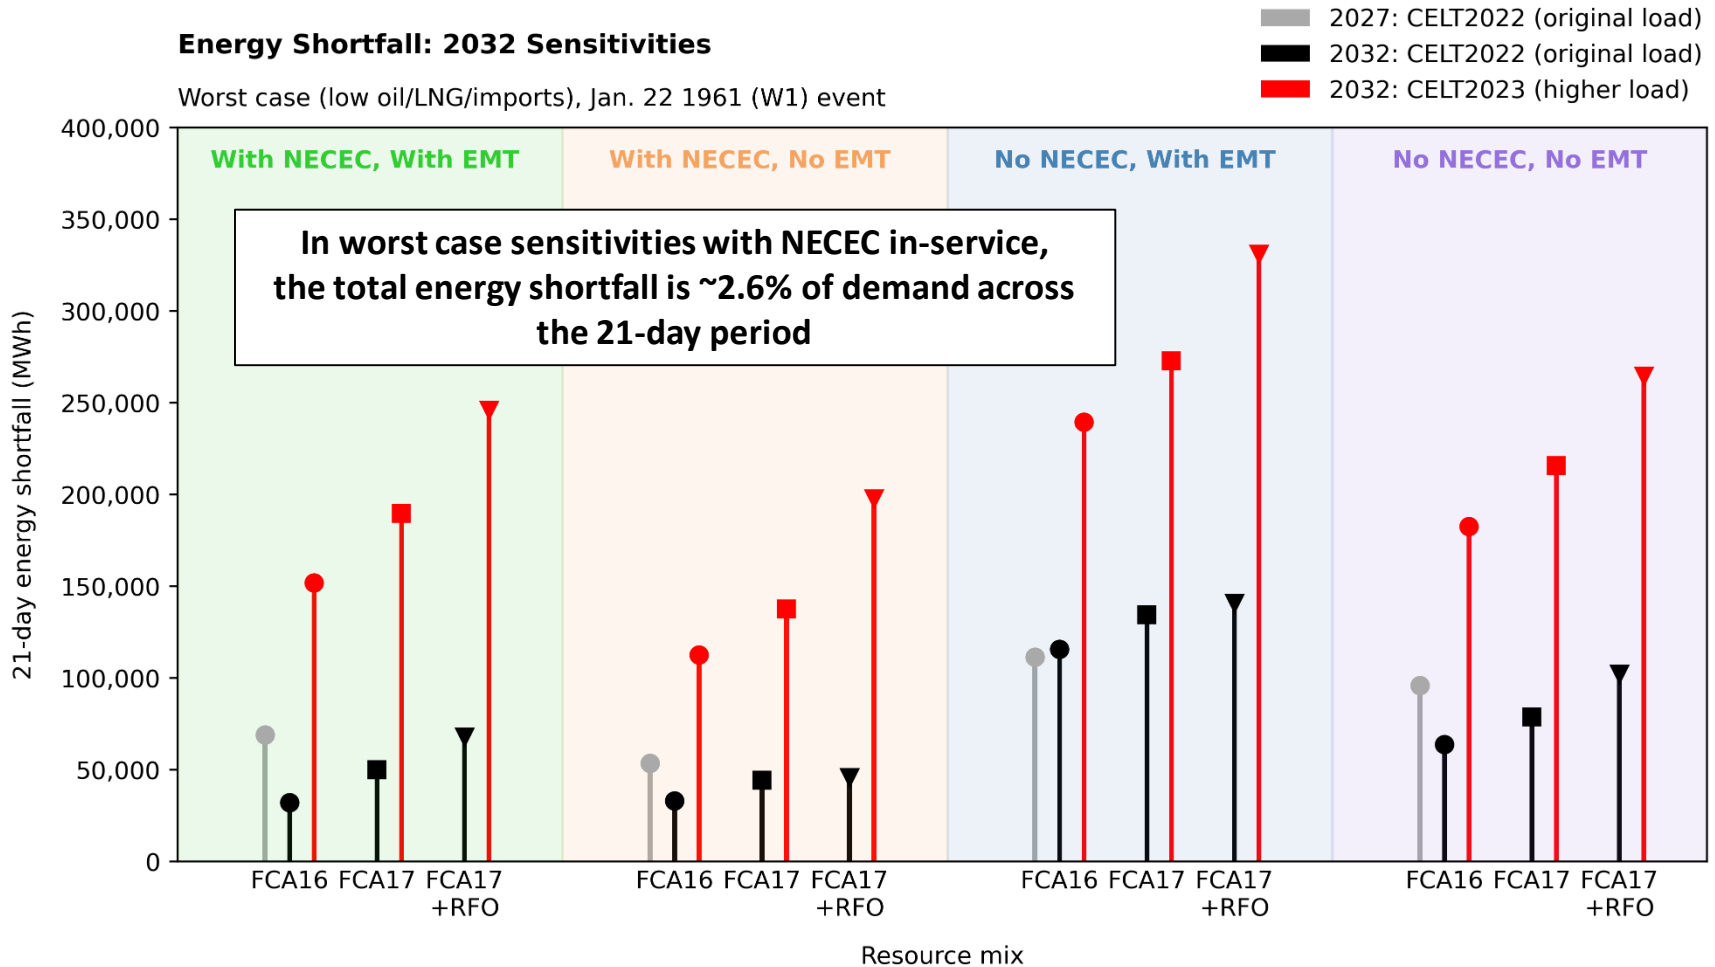

*2027 and 2032 studies based on an FCA 16 resource mix ("FCA16") assume the retirement of ~2,100 MW of capacity that retired in FCA 16 (including Mystic 8&9); 2032 sensitivities that incorporate FCA 17 results ("FCA17") assume the retirement of ~1,600 MW of capacity that delisted in FCA 17 and did not obtain a CSO; 2032 sensitivities that incorporate additional RFO retirement ("FCA17+RFO") assume the retirement of an additional 1,600 MW of RFO capacity above the retirements assumed in FCA 17 sensitivities

Introduction to the Regional Energy Shortfall Threshold

- ISO's 2027 and 2032 energy adequacy study results are expected to help inform the development of a Regional Energy Shortfall Threshold (REST)
 - ISO expects that the REST will be a reliability-based threshold that reflects the region's level of risk tolerance with respect to energy shortfalls during extreme weather
- The REST scope of work was [introduced](#) at the December NEPOOL Reliability Committee meeting; work is expected to continue through 2024
- The magnitude of energy shortfall risk that is expected to be manageable is a key consideration in the development of the REST

More information on the Operational Impacts of Extreme Weather Events Key Project, including ongoing efforts related to development of a Regional Energy Shortfall Threshold, is available on the ISO website: [Operational Impacts of Extreme Weather Events Key Project \(iso-ne.com\)](https://www.iso-ne.com/operational-impacts-of-extreme-weather-events-key-project)

Management of Energy Shortfall Risk Assumes Awareness and Action

- The region's ability to effectively manage energy shortfall risk in advance of low probability 21-day winter events requires situational awareness of the risks and actions by ISO and regional stakeholders
 - ISO's 21-Day Energy Assessment forecast provides situational awareness of regional energy supplies, quantifies potential energy shortfall, and communicates advance warning that action may be necessary
 - With advance warning that action may be necessary, ISO anticipates that market participants will make reasonable efforts to replenish stored fuel supplies, as applicable
 - ISO's well-established emergency operating procedures, including public appeals for conservation, facilitate additional relief in advance of any forecasted energy shortfalls
- At some level of energy shortfall risk, based on magnitude and/or probability, existing risk mitigation actions may be inadequate
- Establishment of the REST is intended to define the level of energy shortfall risk beyond which a set of additional, future solutions may be required



REST Scope of Work

- Establishment of the REST is expected to be a collaborative process with regional stakeholders including the six New England states
- ISO anticipates that the REST scope of work will include, at a minimum, the following components:
 - **What:** Identify the key risk metrics and establish the “threshold(s)”, or criteria, that define the region’s level of risk tolerance with respect to energy shortfall in extreme weather
 - **When:** Determine the periodicity (e.g., annual, seasonal, etc.) and, as applicable, specify the time horizon over which the region’s energy shortfall risk is assessed against the REST
 - **How:** Specify the event selection criteria to be used in determining the set of 21-day events to be considered when using the PEAT framework to assess the region’s energy shortfall risk against the REST
 - An additional item to determine as part of the 2024 work is the effective date for the threshold (i.e., the date when the REST first becomes effective); the effective date is expected to represent the first season where the PEAT framework is used to measure energy shortfall risk against the REST

Expectations for the REST Stakeholder Process

- ISO expects to share its initial REST proposal in May 2024; as part of developing its initial REST proposal ISO plans to solicit stakeholder feedback (details to be announced)
- ISO envisions a multi-month process spanning several RC meetings to allow for proposals, feedback, counter-proposals, and finalization of the REST toward the end of 2024
- ISO also anticipates that periodic discussions with representatives from the New England states will be critical to development of the REST